



**PERMIT TO CONSTRUCT AND OPERATE
Onsite Wastewater System**

File Number: 2014030017
County: Edgefield

SPECIAL INSTRUCTIONS/CONDITIONS

THIS PERMIT IS SITE SPECIFIC ANY CHANGES TO THE SYSTEM MUST BE APPROVED BY DHEC

ANY UNAPPROVED CHANGES WILL VOID THIS PERMIT.

THE SEPTIC TANK CONTRACTOR AND/OR BUILDER MUST READ AND FOLLOW REGULATION 61-56, THE PERMIT AND SPECIAL INSTRUCTIONS BEFORE INSTALLATION

DO NOT CUT, FILL, GRADE OR DISTURB THE PROPOSED INSTALLATION AREA.

STAY AT LEAST 5 FT. AWAY FROM PROPERTY LINES AND BUILDINGS

STAY AT LEAST 75 FT. AWAY FROM PRIVATE WELLS

MAINTAIN AT LEAST 7 FT. OF UNDISTURBED EARTH BETWEEN ABSORPTION TRENCHES

STAY AT LEAST 75 FT. AWAY FROM STREAMS, PONDS, OR NATURAL BODIES OF WATER

DO NOT DRIVE OVER SEWAGE DISPOSAL SYSTEM

STAY AT LEAST 25 FT. AWAY FROM DRAINAGE DITCHES

STAY AT LEAST 15 FT. AWAY FROM THE TOP OF EMBANKMENTS OR CUTS OF 2 FT. OR MORE IN HEIGHT

USE APPROVED SERIAL DISTRIBUTION METHODS (STEP-DOWNS) ON SLOPING LAND SO THAT EACH TRENCH FILLS TO FULL CAPACITY AND THE MAXIMUM DEPTH IS NOT EXCEEDED

Issued/Revised By: _____

Date: _____

Exhibit C

	PERMIT TO CONSTRUCT Onsite Wastewater System	File Nbr 2014030017 County: Edgefield
--	--	---


Name: RICHARD A MILLER	Address: 2880 MARTINTOWN RD NORTH AUGUSTA, SC 29824	Program Code: 362
Type Facility: HOUSE	Site: GARRETT RD SC	System Code: 220
Subdivision:	Lot: 4.28	TM#: 036-00-00-001
Block:		Water Supply: PRIVATE

PERMIT TO CONSTRUCT SYSTEM SPECIFICATIONS			
Daily Flow (gpd): 360	Tank Sizes (gal): Septic Tank: 1000	Pump Chamber:	Grease Trap:
LTAR: .30	Trenches: Length (ft): 520	Width (In): 36	Max. Depth (In): 22
	Min Pump Capacity:	gpm at	ft. of Head
			Agg. Depth (In): 9

SPECIAL INSTRUCTIONS/CONDITIONS

THIS PERMIT IS SITE SPECIFIC. ANY CHANGES TO THE SYSTEM MUST BE APPROVED BY DHEC. ALTERNATIVE TRENCH PRODUCTS APPROVED UNDER STATE RULES AND REGULATIONS MAY BE SUBSTITUTED. ANY UNAPPROVED CHANGES WILL VOID THIS PERMIT.

See Attached Page... *Curtain drain at least 38" deep*

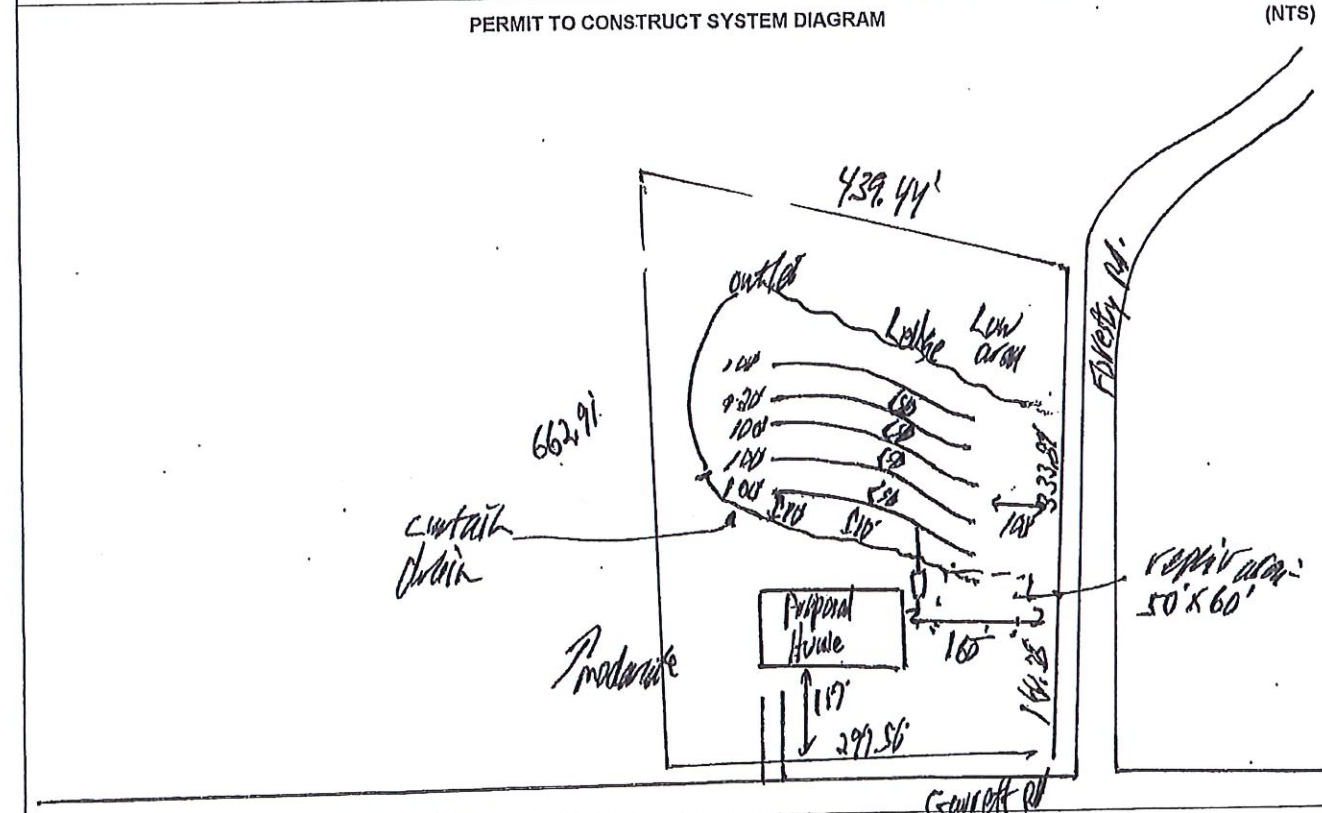

Issued/Revised By: *Kevin W. Mathis* Date: *8-3-14*

DHEC 1781 (01/2014)

This Permit is Appealable Under the Administrative Procedures Act. This Permit will Expire and Become Null and Void Five (5) Years from the Issuance Date.

Kevin W. Mathis