



COMMONWEALTH of VIRGINIA
THREE RIVERS HEALTH DISTRICT

SERVING ESSEX, GLOUCESTER, KING & QUEEN, KING WILLIAM, LANCASTER, MATHEWS, MIDDLESEX, NORTHUMBERLAND, RICHMOND, & WESTMORELAND COUNTIES

RICHARD WILLIAMS, M.D.
DISTRICT DIRECTOR

P.O. BOX 415
SALUDA, VIRGINIA 23149
TELEPHONE: (804) 758-2381
FAX: (804)758-4828

Findings:

Review pursuant to Va. Code § 32.1-165

Name: CRAIG BROSIUS

Phone Number: (763) - 355 - 7249

Subdivision: (If Applicable) _____ Section: _____ Lot: _____

Physical Address: LOT #5 GALWAY DRIVE


Is the existing onsite sewage system safe, adequate and proper, or approvable as nonconforming for the proposed use?

(YES) Comments: The existing septic system is sized correctly & is functioning properly to support the new proposed home.

(NO) Comments: _____

Other Comments: * The new structure will maintain all proper setbacks to the existing septic system (10' minimum)

SITE SKETCH:

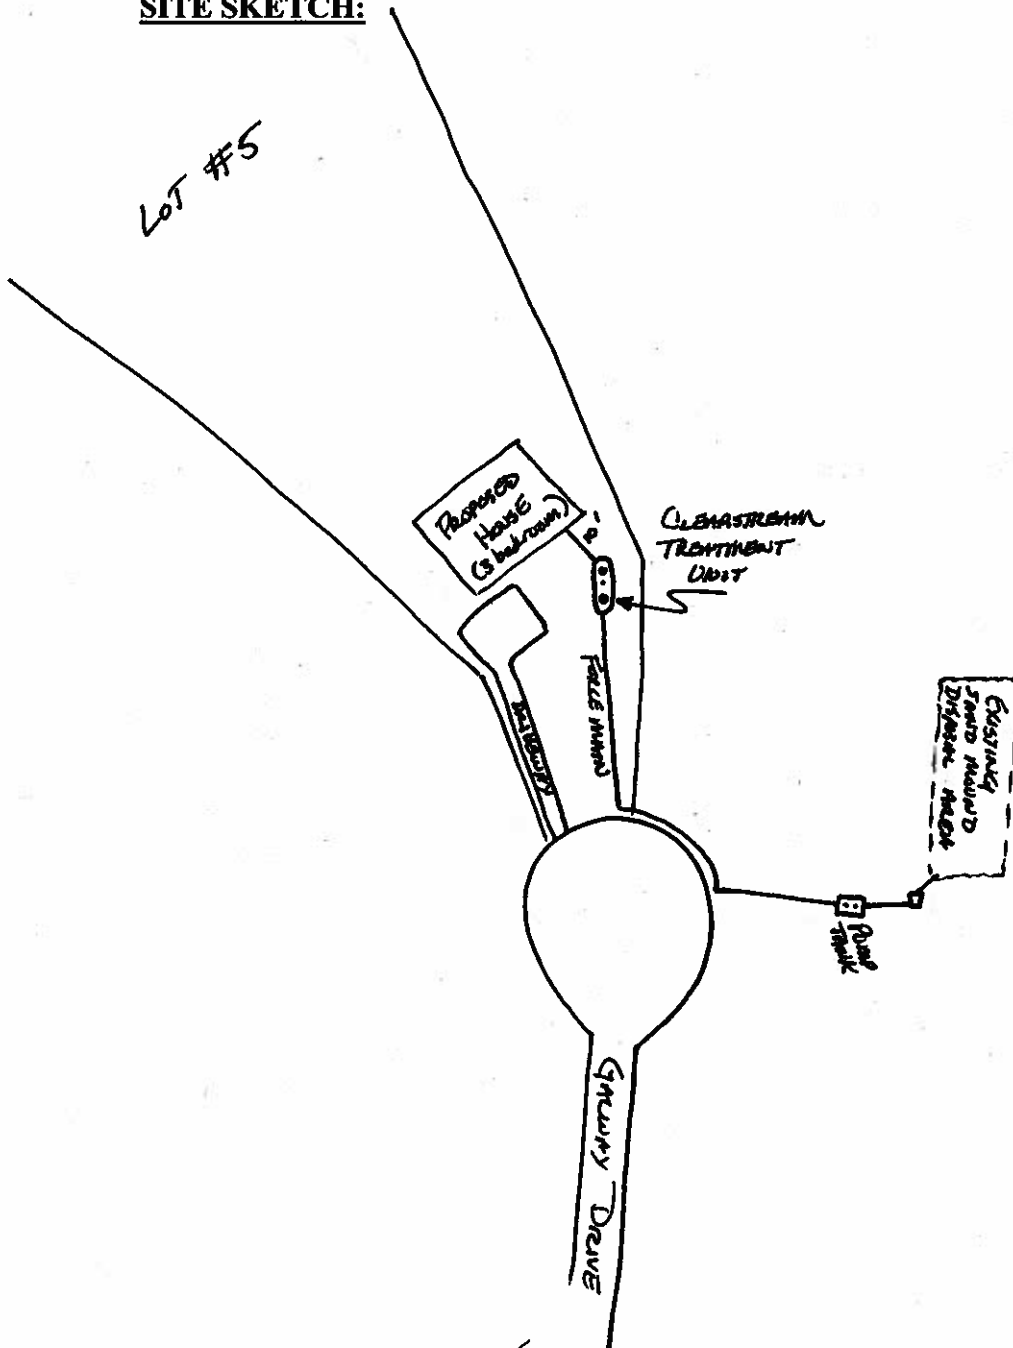

SIGNATURE:

DATE: August 23, 2023

An owner may challenge a denial by requesting an Informal Fact-Finding Conference (IFFC) within 30 days of receipt of a decision. All requests for an IFFC must be sent in writing to the District Health Director and cite the reason for the request.